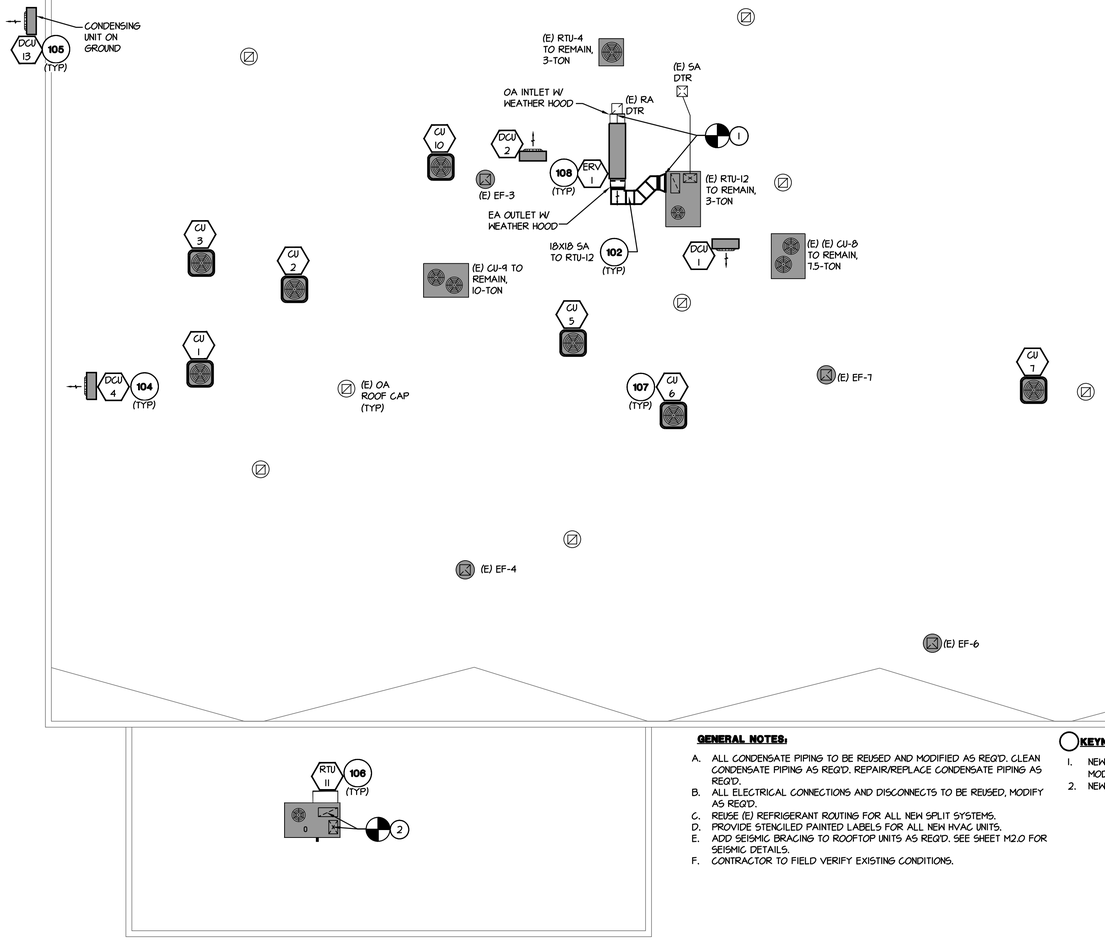

GENERAL NOTES:

A. ALL CONDENSATE PIPING TO BE REUSED AND MODIFIED AS REQ'D. CLEAN CONDENSATE PIPING AS REQ'D. REPAIR/REPLACE CONDENSATE PIPING AS REQ'D.
B. ALL ELECTRICAL CONNECTIONS AND DISCONNECTS TO BE REUSED, MODIFY AS REQ'D.
C. REUSE (E) REFRIGERANT ROUTING FOR ALL NEW SPLIT SYSTEMS.
D. PROVIDE STENCILED PAINTED LABELS FOR ALL NEW HVAC UNITS.
E. ADD SEISMIC BRACING TO ROOFTOP UNITS AS REQ'D. SEE SHEET M2.0 FOR SEISMIC DETAILS.
F. CONTRACTOR TO FIELD VERIFY EXISTING CONDITIONS.

KEYNOTES:

1. NEW CONNECTION TO (E) DUCTWORK/UNIT. MODIFY (E) DUCT AS REQUIRED.
2. NEW CONNECTION TO (E) DTR AND CURB.

MECHANICAL ROOF PLAN

SCALE: 1/8" = 1'-0"

NORTH

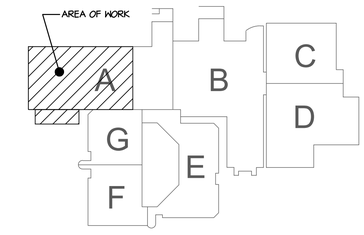

KEYPLAN

NTS

NORTH

Revisions

VOICE: (520) 731-2060
FAX: (520) 731-2061

MECHANICAL ENGINEERING

REGISTERED PROFESSIONAL ENGINEER
32865
PAUL ERIC HEIN
02/21/24
ARIZONA, U.S.A.

YUMA ADULT DETENTION CENTER HVAC REPLACE

141 S THIRD AVENUE
YUMA, AZ. 85364

MECHANICAL ROOF PLAN

Date: 2/2/24
Drawn By: JHB
Checked By: PEH
Scale: AS NOTED
Project Number: 23341
Sheet: M1.2